

Read these instructions before installation and retain for future reference. This equipment should be installed by a competent electrician 


Important Information

We recommend that luminaires are installed by a qualified electrician ensuring the installation complies with current IEE wiring regulations BS7671:2018 & local building control.

- BELL will not accept responsibility for any claims arising from a poor installation.
- The light source of this luminaire is not replaceable: when the light source reaches end of life, the whole luminaire must be replaced.


Warning: Before installation ensure power is disconnected.

Features

- IP65
- Stainless Steel Mounting Plate
- 4000K Colour temperature
- 36/45/60W
- Voltage/Frequency AC220-240 / 50Hz
- Operating temperature -20° to +30°
- Double insulated 
- **No user replaceable parts**



This product may contain substances that can be hazardous to the environment if not disposed of properly. Electrical and electronic equipment should never be disposed of with general household waste but must be separated for its correct treatment and recovery.

Where possible recycle your packaging.

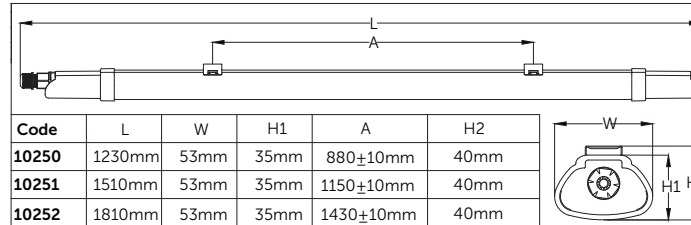Code	L	W	H1	A	H2
10250	1230mm	53mm	35mm	880±10mm	40mm
10251	1510mm	53mm	35mm	1150±10mm	40mm
10252	1810mm	53mm	35mm	1430±10mm	40mm

Warning: Before installation ensure power is disconnected.

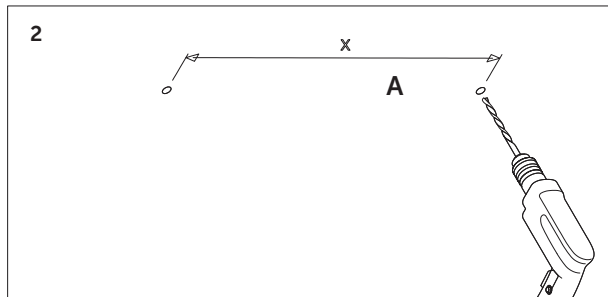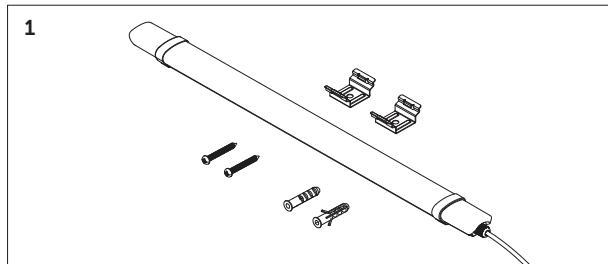

Wiring Instructions

- Remove compression gland and place onto the flex.
- Terminate the flex into the tool-less connections. (Light pressure on the terminations may be required to aid termination).
- Replace compression gland securely on the fitting and tighten the compression dome to seal around the flex.

